

FINISH LEGEND

	ROOM FINISH TAG SURFACE TYPE (SEE SCHEDULE) FINISH NUMBER (SEE SCHEDULE) REMARK NUMBER (SEE SCHEDULE) REMARKS
	ACCENT WALL FINISH - DENOTES AREA & FINISH
	DENOTES FLOOR FINISH MATERIAL CHANGE
	ROOM SIGNAGE COLOR TO BE SELECTED FROM MANUFACTURERS STANDARD RANGE. SEE DETAIL 2/A0.2

FINISH SCHEDULE

F FLOORING		
MARK	MANF.	DESCRIPTION
F0	-	EXISTING TO REMAIN OR N/A
F1	TANGENT	COLOR: BY OWNER
F1	DALTILE	SIZE: 24 X 24 COLOR: BY OWNER
B BASE		
B1	ARMSTRONG	VINYL COLOR: TARKETT SWONBOUND SIZE: 4" HEAT WELDED COVE
W WALLS		
W1	SHERWIN WILLIAMS	COLOR: ROCK CANDY SW6231 FINISH: EGGSHELL
W2	SHERWIN WILLIAMS	COLOR: ARCADE WHITE SW7100 FINISH: EGGSHELL
W3	SHERWIN WILLIAMS	COLOR: KRYPTON SW6247 FINISH: EGGSHELL
W4	SHERWIN WILLIAMS	COLOR: NORTH STAR SW6246 FINISH: EGGSHELL

INTERIOR FINISH REQUIREMENTS

- INTERIOR FINISH REQUIREMENTS ARE BASED ON THE FOLLOWING BUILDING CODE REQUIREMENTS AND OCCUPANCY CLASSIFICATION.
FLORIDA BUILDING CODE - BUILDING 7TH EDITION (2020): CHAPTER 8, INTERIOR FINISHES
OCCUPANCY: BUSINESS GROUP "B"
 - SECTION 803: WALL AND CEILING FINISHES TO COMPLY WITH SECTION 803.1.1.
 - SECTION 803.1.1: INTERIOR WALL AND CEILING FINISH MATERIALS SHALL BE CLASSIFIED IN ACCORDANCE WITH ASTM E84 OR UL723. SUCH INTERIOR FINISH MATERIALS SHALL BE GROUPED ACCORDING TO CLASS IN ACCORDANCE WITH THEIR FLAME SPREAD AND SMOKE-DEVELOPED INDEXES.
 - SECTION 803.1.1: INTERIOR FINISH REQUIREMENTS BASED ON GROUP. INTERIOR WALL AND CEILING FINISH SHALL HAVE A FLAME SPREAD INDEX NOT GREATER THAN THAT SPECIFIED IN TABLE 803.11 FOR THE GROUP AND LOCATION DESIGNATED BELOW IN ITEM "D."
 - INTERIOR WALL AND CEILING FINISH REQUIREMENTS BY OCCUPANCY (PER TABLE 803.11):
 - EXISTING BUILDING IS NOT PROTECTED BY AN AUTOMATIC SPRINKLER SYSTEM.
 - OCCUPANCY GROUP: BUSINESS
 - INTERIOR EXIT STAIRWAYS & RAMP & EXIT PASSAGEWAYS: NOT APPLICABLE TO THIS PROJECT. WORK IS LIMITED TO INTERIOR AREAS
 - CORRIDORS & ENCLOSURES FOR EXIT ACCESS STAIRWAYS & RAMP: NOT APPLICABLE TO THIS PROJECT. WORK IS LIMITED TO INTERIOR AREAS
 - ROOMS & ENCLOSED SPACES: CLASS "C"
 - THE MOST STRINGENT CODE REQUIREMENT SHALL APPLY IN ALL INSTANCES FOR INTERIOR WALL & CEILING FINISH REQUIREMENTS.
- SECTION 804. INTERIOR FLOOR FINISH: THE PROVISIONS OF SECTION 804 SHALL LIMIT THE ALLOWABLE FIRE PERFORMANCE OF INTERIOR FLOOR FINISH MATERIALS BASED ON OCCUPANCY CLASSIFICATION.
 - SECTION 804.1 GENERAL: INTERIOR FLOOR FINISH AND FLOOR COVERING MATERIALS SHALL COMPLY WITH SECTIONS 804.2 THROUGH 804.4.2.
 - SECTION 804.2 CLASSIFICATION: INTERIOR FLOOR FINISH AND FLOOR COVERING MATERIALS REQUIRED BY SECTION 804.4.2 TO BE OF CLASS I OR II MATERIALS SHALL BE CLASSIFIED IN ACCORDANCE WITH NFPA 253. THE CLASSIFICATION REFERRED TO HEREIN CORRESPONDS TO THE CLASSIFICATIONS DETERMINED BY NFPA 253 AS FOLLOWS: CLASS I, 0.45 WATTS/CM2 OR GREATER; CLASS II, 0.22 WATTS/CM2 OR GREATER.
 - SECTION 804.3 TESTING AND IDENTIFICATION: INTERIOR FLOOR FINISH AND FLOOR COVERING MATERIALS SHALL BE TESTED BY AN AGENCY IN ACCORDANCE WITH NFPA 253 AND IDENTIFIED BY A HANG TAG OR OTHER SUITABLE METHOD SO AS TO IDENTIFY THE MANUFACTURER OR SUPPLIER AND STYLE, AND SHALL INDICATE THE INTERIOR FLOOR FINISH OR FLOOR COVERING CLASSIFICATION IN ACCORDANCE WITH SECTION 804.2. CARPET-TYPE FLOOR COVERINGS SHALL BE TESTED AS PROPOSED FOR USE, INCLUDING UNDERLAYMENT. TEST REPORTS CONFIRMING THE INFORMATION PROVIDED IN THE MANUFACTURER'S PRODUCT IDENTIFICATION SHALL BE FURNISHED TO THE BUILDING OFFICIAL UPON REQUEST.
 - SECTION 804.4 INTERIOR FLOOR FINISH REQUIREMENTS: INTERIOR FLOOR COVERING MATERIALS SHALL COMPLY WITH SECTIONS 804.4.1 AND 804.4.2 AND INTERIOR FLOOR FINISH MATERIALS SHALL COMPLY WITH SECTION 804.4.2.
 - 804.4.1 TEST REQUIREMENT: IN ALL OCCUPANCIES, INTERIOR FLOOR COVERING MATERIALS SHALL COMPLY WITH THE REQUIREMENTS OF THE DOC FF-1 "PILL TEST" (CFSC 16 CFR PART 1630) OR WITH ASTM D2859.
 - 804.4.2 MINIMUM CRITICAL RADIANT FLUX: IN ALL OCCUPANCIES, INTERIOR FLOOR FINISH AND FLOOR COVERING MATERIALS IN ENCLOSURES FOR STAIRWAYS AND RAMP, EXIT PASSAGEWAYS, CORRIDORS AND ROOMS OR SPACES NOT SEPARATED FROM CORRIDORS BY PARTITIONS EXTENDING FROM THE FLOOR TO THE UNDERSIDE OF THE CEILING SHALL WITHSTAND A MINIMUM CRITICAL RADIANT FLUX: THE MINIMUM CRITICAL RADIANT FLUX SHALL BE NOT LESS THAN CLASS I IN GROUPS I-1, I-2 AND I-3 AND NOT LESS THAN CLASS II IN GROUPS A, B, E, H, I-4, M, R-1, R-2 AND S.
 - PER SECTION 804.4.2, FOR THIS PROJECT, THE INTERIOR FLOOR FINISHES AND FLOOR COVERINGS SHALL BE OF CLASS II MATERIALS.

C CEILINGS

MARK	MANF.	DESCRIPTION
C0	-	EXISTING TO REMAIN OR N/A
C1	ARMSTRONG	DUNE STYLE: 1902 - BEVELED TEGULAR SIZE: 12" X 12" GRID: 15/16 PRELUDE GRID

M MILLWORK

MARK	MANF.	DESCRIPTION
M0	-	EXISTING TO REMAIN OR N/A
M1	FORMICA	PLASTIC LAMINATE COLOR: DOVER WHITE
M2	FORMICA	PLASTIC LAMINATE COLOR: FOX TEAKWOOD
M3	FORMICA	SOLID SURFACE COLOR: ASH CONCRETE
M4	FORMICA	SOLID SURFACE COLOR: LUNA SAND

ADD ALTERNATE:
 PLASTIC LAMINATE
 COLOR: PALOMA POLAR

R REMARKS

- PAINT ALL DOOR AND WINDOW TRIMS WITH W2




INTERIOR MODIFICATIONS
 FOR
 NEW TFS PHYSICIAN CLINIC
 900 S.E. BECKER ROAD
 PORT ST. LUCIE, FLORIDA 34983

09/28/2022 - CONSTRUCTION DOCUMENTS

PROJECT NO.: 22037.02

This drawing sheet has been digitally signed & sealed by Christopher A. Sable on the date indicated in digital signature. Printed copies of this document are not considered signed & sealed and the digital signature must be verified on any electronic copies.

©BLOC 3 DESIGN, INC.

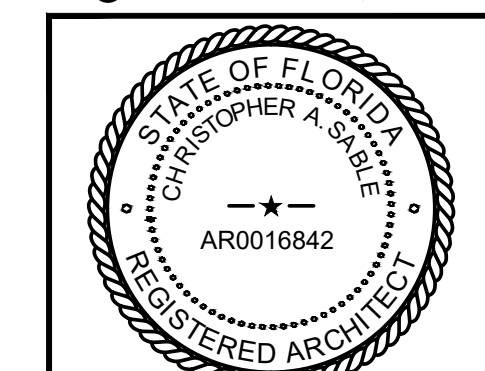

CHRISTOPHER A. SABLE AR0016842
PRINCIPAL, BLOC 3 DESIGN, INC.

FINISH PLAN

THIS SHEET IS PART OF THE DOCUMENT SET LISTED ON COVER SHEET AND SHALL NOT BE SEPARATED

A11.1