


Warner-A Arabella III-B Fullerton V-B Fullerton V-B Arabella III-B Warner-A

2nd FLOOR BEARING HEIGHT SCHEDULE	1st FLOOR BEARING HEIGHT SCHEDULE
8'-8" Brg With Overall Ht. 19'-2"	10'-6" Brg.
9'-7" Brg With Overall Ht. 20'-1"	9'-0" Brg
10'-0" Brg With Overall Ht. 20'-6"	9'-0" Brg
Raked Fire Wall	9'-0" Int. Brg.
	Low Wall

Floor Ledgers By Bldr. Top @ 10'-3"

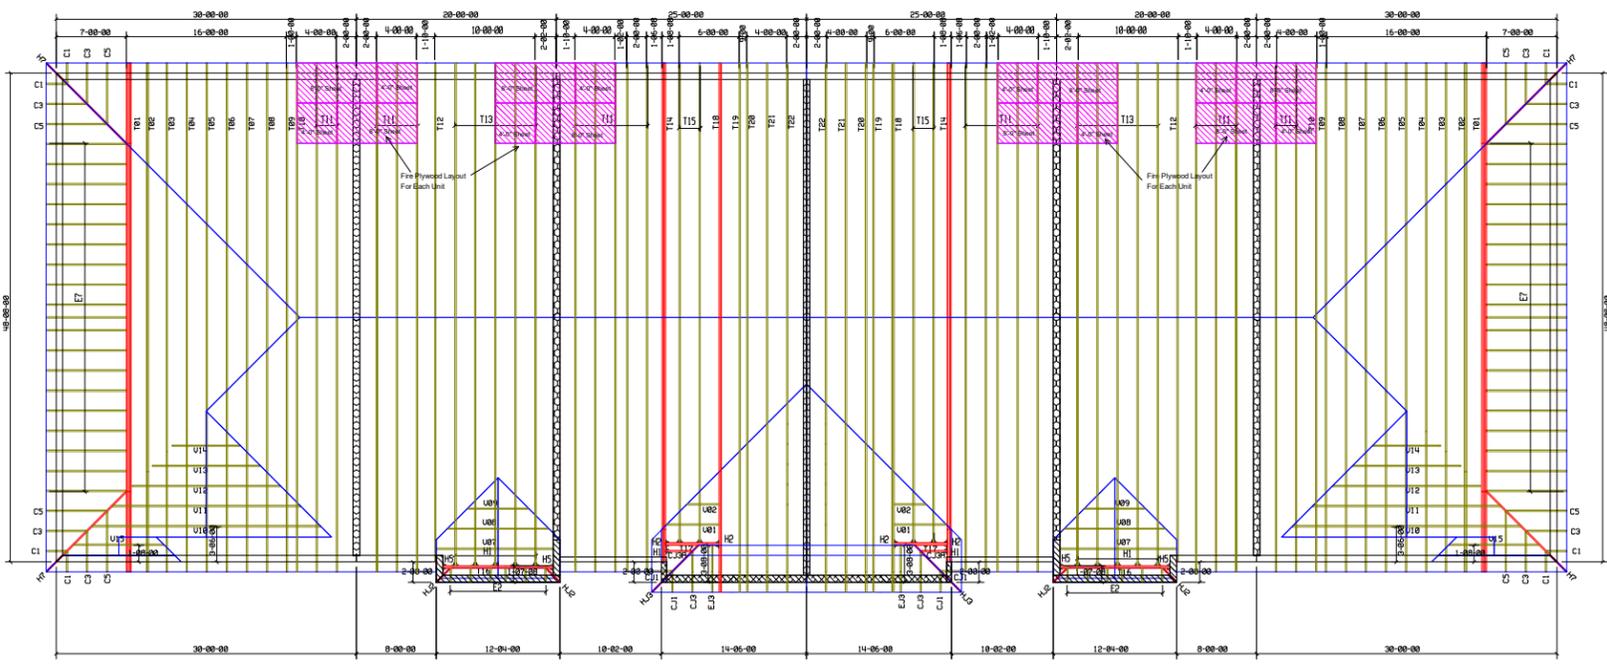

Warner-A Arabella III-B Fullerton V-B Fullerton V-B Arabella III-B Warner-A

- Hanger List**
- H1 HTU26
 - H2 THA422
 - H3 HGUS26-2
 - H4 HHUS46
 - H5 HGR By Builder
 - H7 THJA26

TRUSS SHOP DRAWING REVIEW
ARCHITECTURAL STUDIO, INC.

THE SHOP DRAWING REVIEW IS ONLY FOR CONFORMANCE WITH THE INFORMATION GIVEN AND THE DESIGN CONCEPT OF THE PROJECT AS EXPRESSED IN THE ARCHITECT'S DRAWINGS. REVIEW OF SUBMITTALS ARE NOT CONDUCTED FOR THE PURPOSE OF DETERMINING THE ACCURACY AND COMPLETENESS OF DETAILS, SUCH AS DIMENSIONS AND QUANTITIES OR FOR SUBSTITUTING INSTRUCTIONS FOR THE INSTALLATION OR PERFORMANCE OF EQUIPMENT OR SYSTEMS. ALL OF WHICH REMAIN THE RESPONSIBILITY OF THE CONTRACTOR. THE FABRICATOR IS RESPONSIBLE FOR NOTIFYING THE GENERAL CONTRACTOR IS WRITING FOR ANY DEVIATION FROM THE ARCHITECT'S LAYOUT. THE GENERAL CONTRACTOR IS RESPONSIBLE FOR COORDINATING AND RESOLVING ANY INCONSISTENCIES BETWEEN THE SHOP DRAWINGS AND OTHER APPLICABLE TRADES: INCLUDING ARCHITECTURAL, STRUCTURAL OR M.E.P. THE ARCHITECT'S REVIEW SHALL NOT CONSTITUTE APPROVAL OR ANY CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES OR ANY SAFETY PRECAUTIONS OR PROCEDURES. THE ARCHITECT'S APPROVAL OF SPECIFIC ITEM SHALL NOT INDICATE APPROVAL OF AN ASSEMBLY OF WHICH THE ITEM IS A COMPONENT.

- REVIEWED; NO EXCEPTIONS TAKEN
- REVIEWED WITH COMMENTS NOTED

BY: **APPROVED** DATE: **12/2/22**
By Karina Casali at 12:11 pm, Dec 05, 2022

- NOTES:**
- 1) REFER TO HD 91 (RECOMMENDATIONS FOR HANDLING INSTALLATION AND TEMPORARY BRACING). REFER TO ENGINEERED DRAWINGS FOR PERMANENT BRACING REQUIRED.
 - 2) ALL TRUSSES (INCLUDING TRUSSES UNDER VALLEY FRAMING) MUST BE COMPLETELY DECKED OR REFER TO DETAIL V05 FOR ALTERNATE BRACING REQUIREMENTS.
 - 3) ALL VALLEYS ARE TO BE CONVENTIONALLY FRAMED BY BUILDER.
 - 4) ALL TRUSSES ARE DESIGNED FOR 2' o.c. MAXIMUM SPACING, UNLESS OTHERWISE NOTED.
 - 5) ALL WALLS SHOWN ON PLACEMENT PLAN ARE CONSIDERED TO BE LOAD BEARING, UNLESS OTHERWISE NOTED.
 - 6) SY42 TRUSSES MUST BE INSTALLED WITH THE TOP BEING UP.
 - 7) ALL ROOF TRUSS HANGERS TO BE SIMPSON HTU26 UNLESS OTHERWISE NOTED. ALL FLOOR TRUSS HANGERS TO BE SIMPSON THA422 UNLESS OTHERWISE NOTED.
 - 8) BEAM/HEADER/LINTEL (HDR) TO BE FURNISHED BY BUILDER.

SHOP DRAWING APPROVAL

THIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

Requested Delivery Date: _____
Approved by: _____ Date: _____

Builders FirstSource
Orlando
PHONE: 407-851-2100 FAX: 407-851-7111
Plant City
PHONE: 813-759-5951 FAX: 813-752-1532

Rev. 4/21/22

BUILDER: **K Hovnanian Homes**

WORK: 6 Unit Warner-A, Arabella III-B, Fullerton V-B Fullerton V-B, Arabella III-B, Warner-A

LEGAL ADDRESS: Bldg 9 Units 870-900 NE Trail Side Run REVISION: NTS
DATE: 12/2/22 DRAWN BY: Terry USER: 3357849
SCALE: 1/8" = 1'-0" 3357848

<p>MAIN WIND FORCE RESISTING SYSTEM: C-HYBRID WIND ASCE7-16</p> <p>ENCLOSURE: EXPOSURE CATEGORY: "C"</p> <p>OCCUPANCY CATEGORY: II</p> <p>WIND LOAD: 170</p> <p>WIND IMPORTANCE FACTOR: 1.00</p> <p>TRUSSES HAVE BEEN DESIGNED FOR A 10.0PSF BOTTOM CHORD LIVE LOAD</p> <p>NONCONCURRENT WITH ANY OTHER LIVE LOADS</p>	<p>ROOF LOADING</p> <p>TCLL: 30 PSF</p> <p>TCDL: 15 PSF</p> <p>BCDL: 10 PSF</p> <p>TOTAL: 55 PSF</p> <p>DURATION: 1.33</p> <p>BUILDING CODE: FBC2020/TP12014</p>	<p>FLOOR LOADING</p> <p>TCLL: 40 PSF</p> <p>TCDL: 20 PSF</p> <p>BCDL: 5 PSF</p> <p>TOTAL: 65 PSF</p> <p>DURATION: 1.00</p> <p>BUILDING CODE: FBC2020/TP12014</p>
--	---	---